

# **Exit Routes, Emergency Action Plans, Fire Prevention Plans, and Fire Protection**

## **OSHA 10-Hour General Industry Outreach Training**

# Introduction



Fires and explosions, as well as other workplace incidents, may require emergency actions and evacuations to protect employees.

# Introduction

## Lesson objectives:

1. Recognize benefits of an Emergency Action Plan.
2. Identify elements of Fire Protection Plan.
3. Identify conditions under which evacuation actions may be necessary in an emergency situation.
4. Identify conditions under which shelter-in-place may be necessary in an emergency situation.

# Introduction

5. Identify characteristics of an effective emergency escape route.
6. Recognize the five types of fire extinguishers, including the types of fires they can extinguish.
7. Review requirements for proper maintenance of portable fire extinguishers.

# Emergency Action Plans

## Benefits of an EAP:

- Written document that facilitates and organizes employer and employee actions during workplace emergencies
- Fewer and less severe injuries
- Less structural damage
- Reduce confusion

# Emergency Action Plans

## Purpose of an EAP:

- Describes actions to be taken to ensure employee safety during an emergency
- Uses floor plans/maps to show emergency escape routes
- Tells employees what actions to take
- Covers reasonably expected emergencies



# Emergency Action Plans

Required elements of plan:

- Means of reporting
- Evacuation procedures and emergency escape routes
- Procedures for critical operations
- Accounting of employees
- Rescue and medical duties
- Contact persons



Source of graphics: OSHA

# Emergency Action Plans

- Training employees on the EAP
  - Review plan with each employee
    - Initial development of plan
    - Initial assignment of employee to job
    - Changes to plan or employee actions/responsibilities
  - Annual retraining with drills to practice evacuation and gathering in assembly area
  - Educate/train
    - Types of emergencies
    - Course of actions
    - Functions and elements of EAP
    - Special hazards
    - Fire hazards and fire prevention plan



Source: OSHA



# Emergency Action Plans

- General training
  - Roles and responsibilities
  - Threats, hazards, protective actions
  - Notification, warning, communications
  - Locating family members
  - Location/use of emergency equipment
  - Procedures
    - Emergency response
    - Evacuation and shelter-in-place
    - Assembly and accounting of employees
    - Emergency shut-down



Source of graphics: OSHA

# Emergency Action Plans

## Examples of procedures:

- Methods of reporting an emergency
- Instructions for exit
- Instructions for limited mobility



Source of graphics: OSHA

# Fire Prevention Plan

## FPP requirements:

- Must be
  - In writing
  - Kept in the workplace
  - Available to employees for review
- Employer must
  - Inform employees of fire hazards when initially assigned to a job
  - Review with each employee applicable FPP parts



Source: OSHA


# Fire Prevention Plan

- Included in FPP
  - Lists of all major fire hazards, proper handling and storage of hazardous materials, ignition sources/controls, and fire protection equipment
  - Procedures to control flammable/combustible wastes
  - Procedures for maintenance of safeguards on heat-producing equipment
  - Name/job titles of employees with responsibilities for maintenance of equipment and control of hazards

# Fire Prevention Plan

## Preventing fires hazards:

- Understanding fires
  - Rapid chemical reaction between oxygen and a combustible material
  - Results in release of heat, light, flames, and smoke
  - Requires four elements:
    - Oxygen
    - Ignition source (heat)
    - Fuel
    - Chemical reaction

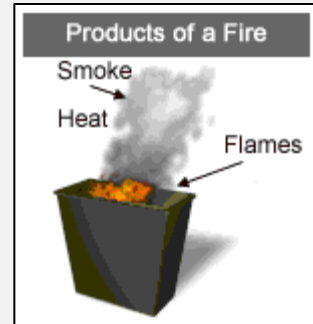

Source of graphics: OSHA

# Fire Prevention Plan

- Ignition sources
  - Open flames
  - Smoking
  - Static electricity
  - Hotwork
  - Hot surfaces
  - Electrical and mechanical sparks
  - Lightning



Source: CDC



<b>WARNING</b>	
NO SMOKING--NO HOT WORK	
SPRAY PAINTING	
PAINT TYPE	124 White
COMP # / LOCATION	2-300-0-L Compartment
SHIFT	Second L/P Joe Painter
START DATE	6-14-2001
FINISH DATE	6-18-2001
AUTHORIZED PERSONNEL ONLY	




Source of graphics: OSHA



# Fire Prevention Plan

- Tasks that require fire protection and examples of hazards
  - Hotwork – 30-minute fire watch
  - Dispensing flammables and combustibles: gasoline, diesel, or natural gas
  - Flammable wastes: solvent waste, oily rags, and flammable liquids

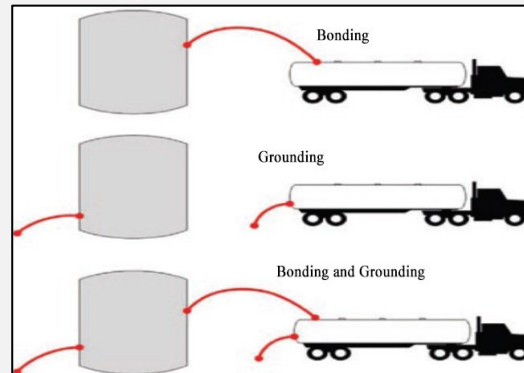

Source of graphics: OSHA



# Fire Prevention Plan

- Handling of flammable hazards
  - Only use approved metal safety containers or original manufacturer's containers for storage
  - Practice good housekeeping
  - Keep containers closed when not in use
  - Store away from exits or passageways
  - Keep away from ignition sources



Source of graphics: OSHA

# Fire Prevention Plan

- Fire protection equipment
  - PPE
  - Fire Suppression
    - Portable fire extinguishers
    - Fixed systems



Source of graphics: OSHA

# Conditions Requiring Evacuation

Workplace evacuation may be required for:

- **Man-made emergencies**
  - Fires
  - Explosions
  - Toxic material releases
  - Radiological/biological incidents
  - Civil disturbances
  - Workplace violence
- **Natural emergencies**
  - Floods
  - Earthquakes
  - Hurricanes
  - Tornadoes
  - Wildfires
  - Winter weather

# Conditions Requiring Evacuation

Factors affecting response to emergencies:

- Type/extent of emergency
- Location of emergency
- Type of building in which workplace is located
- Shutting down critical operations



Source of graphics: OSHA

# Conditions Requiring Evacuation

Fire emergencies:

## **Fight or Flee?**

- Options for evacuation
  1. Total evacuation
  2. Designated employees authorized to fight fire; all others evacuate
  3. All employees authorized to fight fire
  4. Extinguishers provided but not intended for employee use



Source of graphics: OSHA



# Conditions Requiring Evacuation

Fire emergencies:

## **Fight or Flee?**

- Performing a risk assessment
  - Is the fire too big?
  - Is the air safe to breathe?
  - Is the environment too hot or smoky?
  - Is there a safe evacuation path?




Source: OSHA

# Conditions Requiring Evacuation

Evacuation maps show:

- Exits: to, thru, and away
- At least two ways out
  - Primary exit
  - Secondary exit
- Assembly area
- Location on the map
- Additional information –
  - Location of fire extinguishers

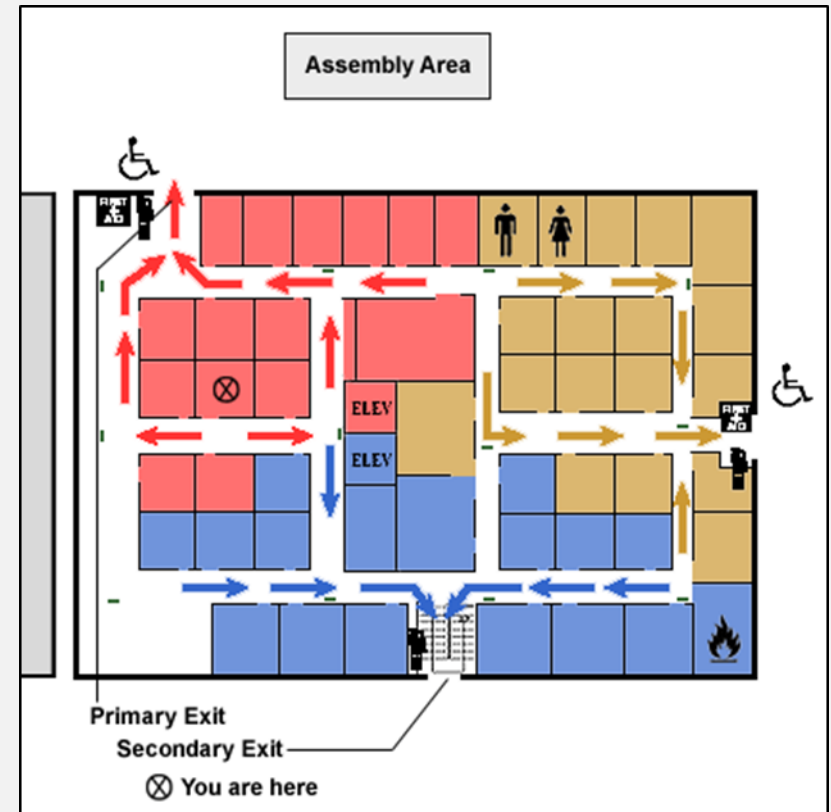

Source: OSHA

# Conditions Requiring Evacuation

## Evacuation actions:

- Alerting employees to **evacuate**
  - Alarm
  - Enunciator panel/speaker
- Accounting for who has **exited**
  - How is that accomplished
- Keeping employees **informed**
  - All clear, re-enter, or remain at assembly point
  - Clear to leave workplace



Source of graphics: OSHA

# Conditions Requiring Shelter-in-Place

Incidents that may require shelter-in-place:

- Release of chemical, biological, or radiological contaminants
- Severe weather – tornadoes
- Other situations occurring outside the workplace



Source: CDC




Source: FEMA Region VI

# Conditions Requiring Shelter-in-Place

## Shelter-in-place:

- Means taking refuge in interior room(s) with no/few windows
- Local authorities often issue shelter-in-place advice via TV or radio
- Procedures specific to worksite

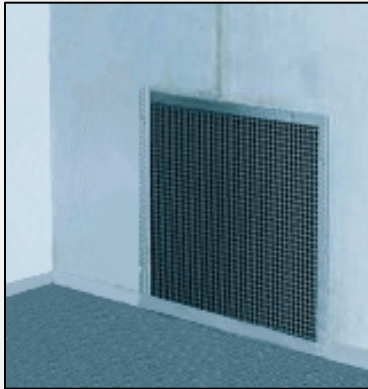

Source of graphics: OSHA



# Conditions Requiring Shelter-in-Place

Planning shelter-in-place actions:

- Alerting employees – *shelter-in-place*
- Accounting for who is in *refuge*
- Keeping employees informed



Source of graphics: OSHA



# Emergency Escape Routes

## Exit routes:


- Continuous and unobstructed path of exit travel from any place in workplace to safety
- Exit access, exit, exit discharge
- Should be:
  - Clearly marked
  - Well-lit
  - Appropriate width
  - Unobstructed/clear



Source: TEEEX

# Emergency Escape Routes


- Basic exit route requirements:
  - Permanent
  - Separated by fire-resistant materials
  - Limited openings
  - Adequate number of exit routes
  - Discharge leading directly outside or to a place with access to outside
  - Exit door unlocked from inside and side-hinged
  - Adequate capacity
  - Minimum height and width

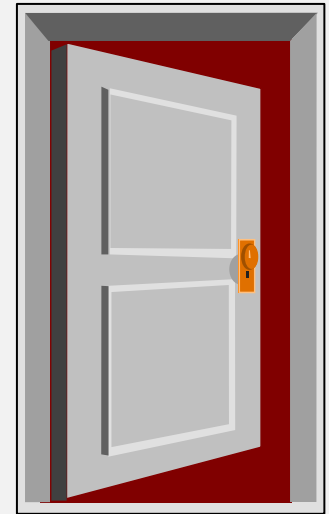


Source of graphics: OSHA

# Emergency Escape Routes

- Clearly communicate 3 elements of escape route
  - Exit access pathway
  - Nearest exits from all points of building
  - Pathway away from building structure

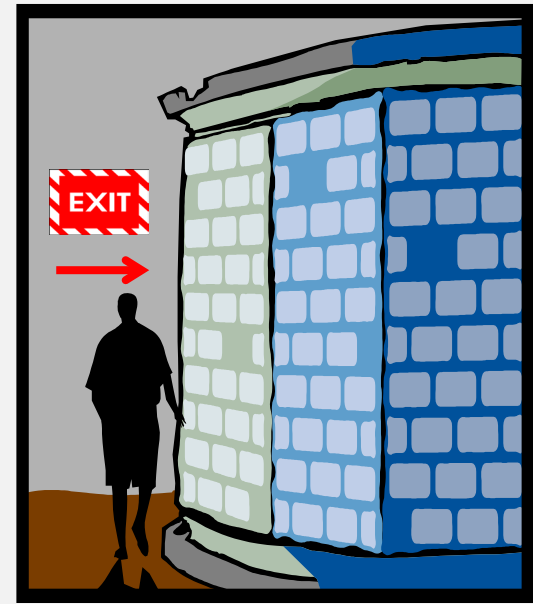


Source of graphics: OSHA

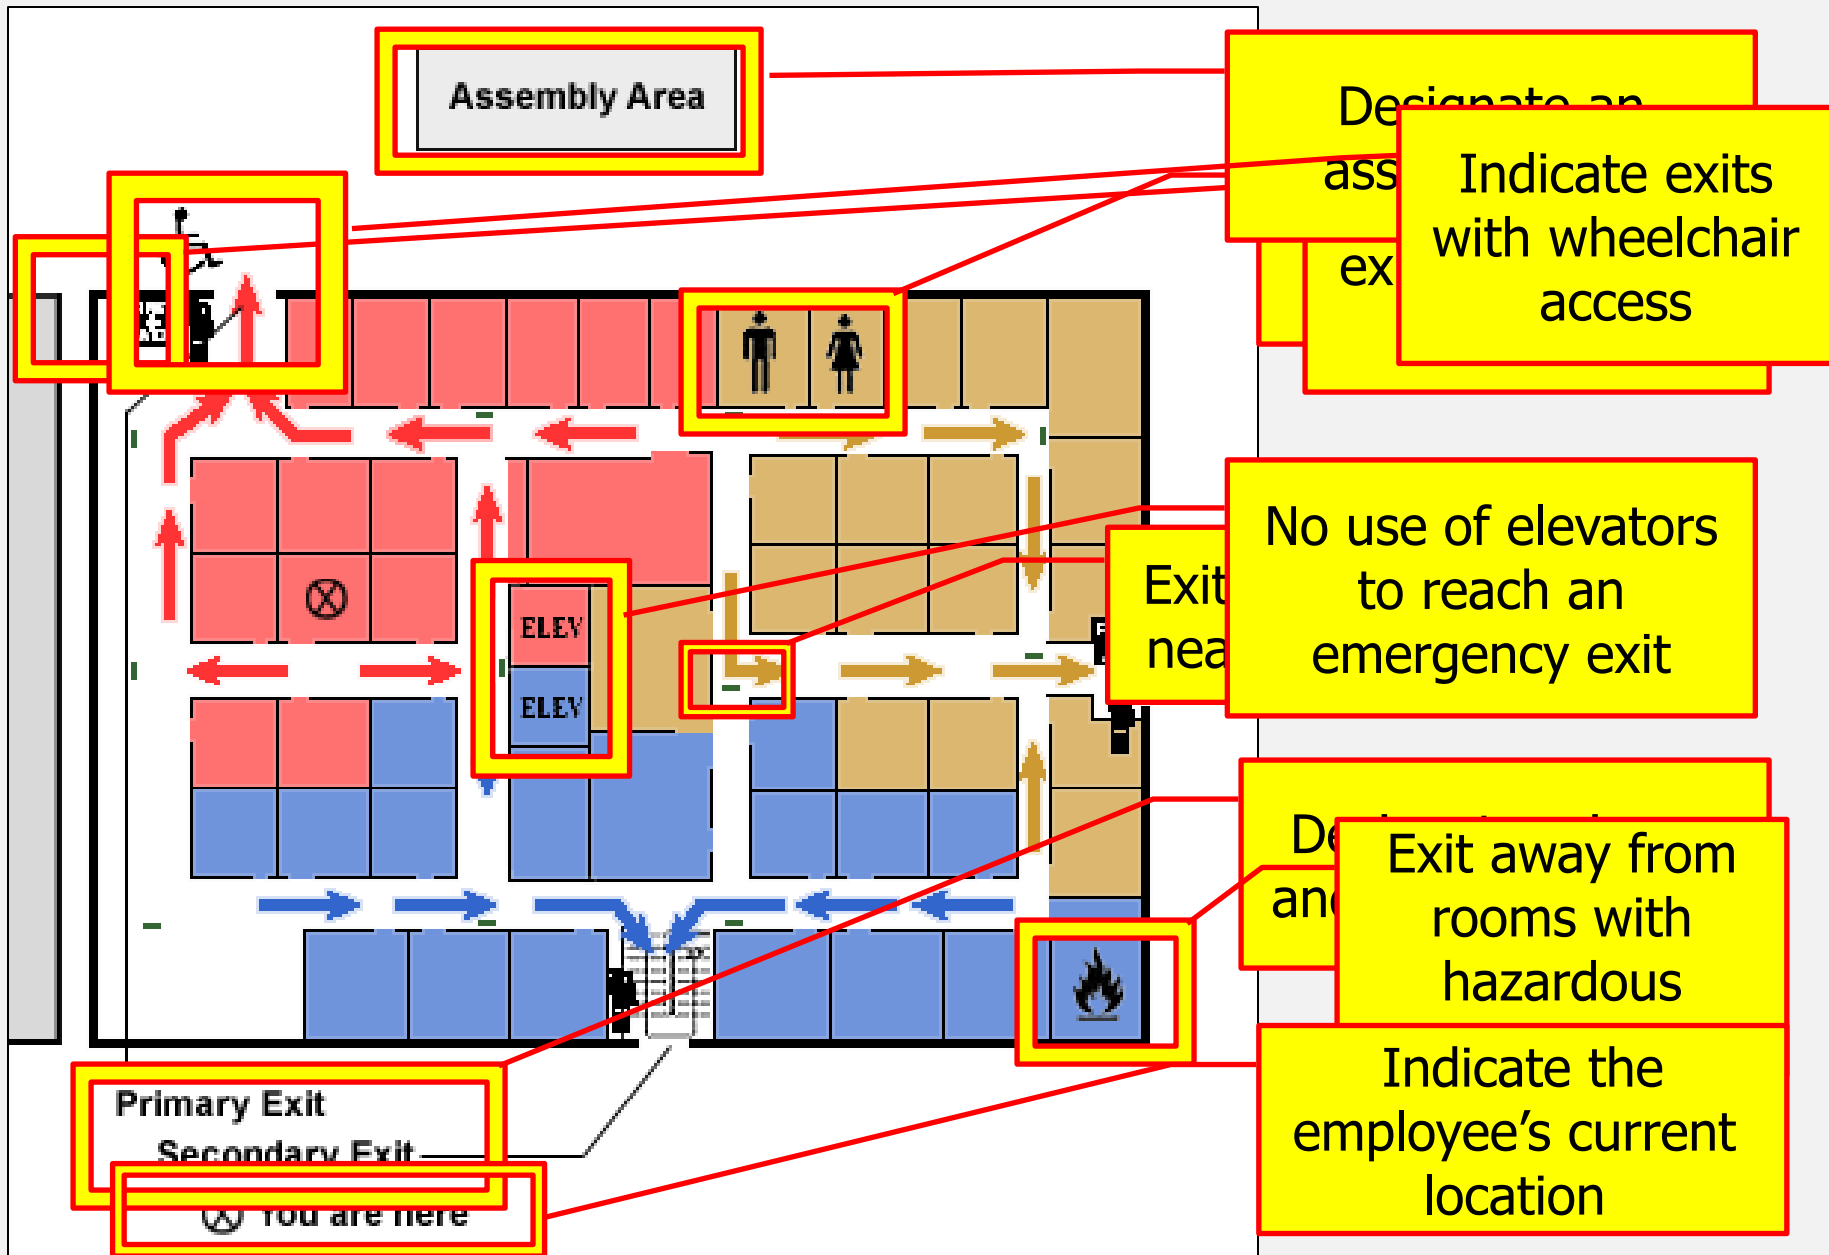

# Extinguishing Fires

Methods of fire protection:

- Fixed extinguishing systems
- Fire brigades
- Fire extinguishers

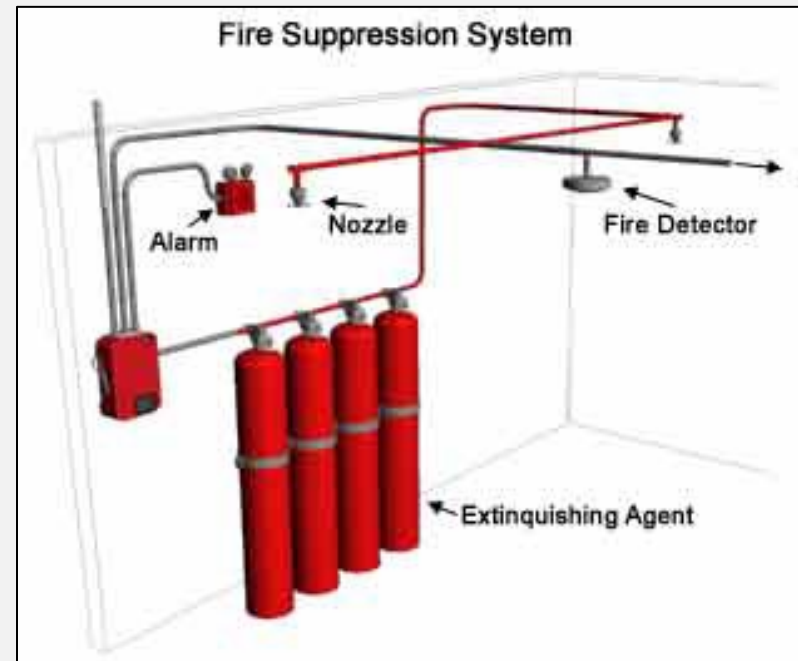

Source of graphics: OSHA

# Extinguishing Fires

- Portable fire extinguisher training and education
  - Required for employees authorized to use fire extinguishers
  - General principles of fire extinguisher use
  - Hazards of incipient stage fire fighting
  - Operation of equipment (instruction and hands-on practice)
  - Required upon initial employment/assignment and at least annually thereafter




Source: OSHA



# Extinguishing Fires

## Classes of fires:

- Class A – ordinary combustibles
- Class B – flammable liquids and gases
- Class C – energized electrical equipment
- Class D – combustible metals
- Class K – cooking oils and greases

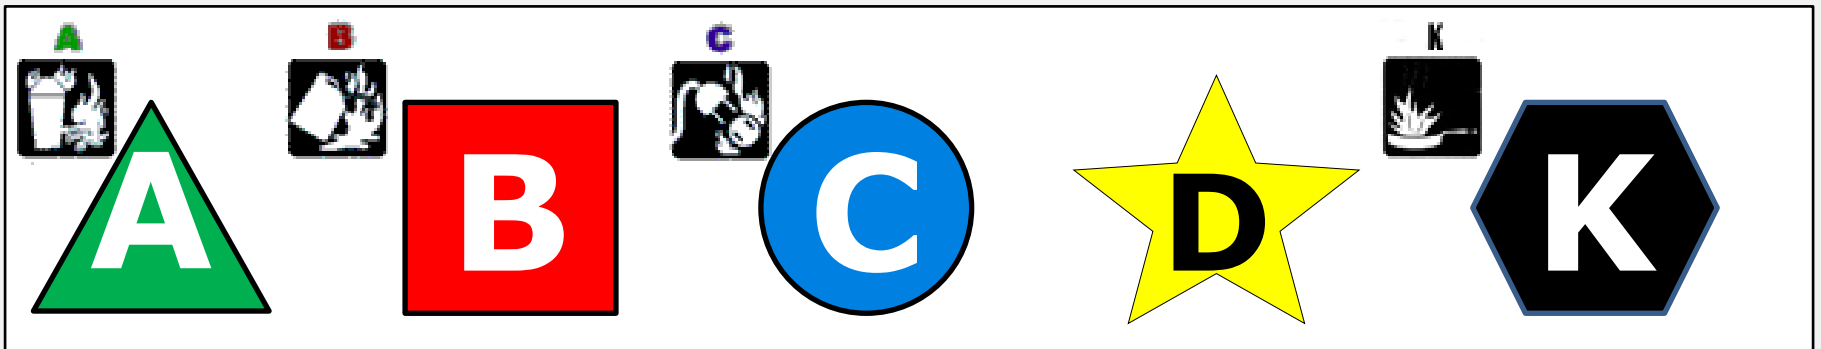

Source: OTIEC

# Extinguishing Fires

- How fire extinguishers work
  - Remove heat
  - Displace/remove oxygen
  - Stop chemical reaction



Source: OSHA

# Extinguishing Fires

- Parts of a fire extinguisher and labels



Source of graphics: OSHA

# Extinguishing Fires

Types of extinguishers:

- Water
- Carbon Dioxide
- Dry Chemical



Source: OSHA

# Extinguishing Fires


- Water or air-pressurized water (APW) extinguishers
  - Designed for **Class A fires only**
  - Large silver container, 2 to 3 ft. tall, weighing about 25 lbs. when full
  - Filled 2/3 with ordinary water, then pressurized with air
  - Detergents may be added
  - Cool the surface to remove the heat
  - **Never use to extinguish flammable liquid fires or electrical fires**



Source of graphics: OSHA

# Extinguishing Fires

- Carbon Dioxide (CO<sub>2</sub>) extinguishers
  - Designed for **Class B and Class C fires only**
  - Red cylinders, ranging from 5 to 100 lbs. or larger, with a hard horn and no pressure gauge
  - Filled with Carbon Dioxide (CO<sub>2</sub>), under extreme pressure
  - Displace oxygen; dry ice pieces also have cooling effect
  - **Never use in confined space without respiratory protection**

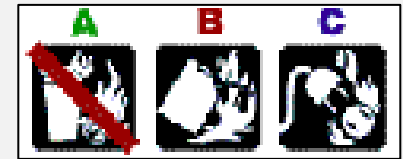


Source of graphics: OSHA



# Extinguishing Fires


- Dry Chemical extinguishers (Multi-purpose)
  - May be used on **Class A, Class B, and/or Class C fires** (check label)
  - Red cylinders, ranging in size from 5 to 20 lbs.
  - Fire-retardant powder is the extinguishing agent and is propelled by a compressed, non-flammable gas
  - Separates fuel from oxygen; powder also interrupts chemical reaction

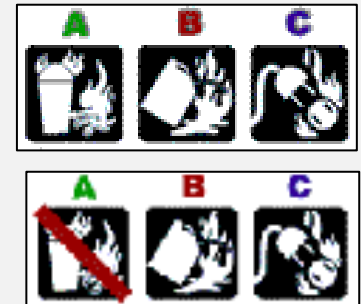

Source of graphics: OSHA

# Extinguishing Fires

- Class K – dry and wet chemical extinguishers
  - Designed for **kitchen fires**
  - Only intended to be used after activation of built-in hood suppression system
  - Filled with electrically conductive extinguishing agents; use only after electrical power to appliance has been shut off
  - Potassium bicarbonate may be used in dry types; wet chemical extinguishers spray a fine mist



Source of graphics: OSHA

# Extinguishing Fires

## Using a fire extinguisher:

- Steps to follow
  1. Sound alarm; call fire department
  2. Identify safe evacuation path
  3. Select appropriate fire extinguisher
  4. Discharge extinguisher using P.A.S.S. technique
  5. Back away once extinguished
  6. Evacuate immediately if necessary
    - Extinguisher empty and fire is not out
    - Fire progresses beyond incipient stage

# Extinguishing Fires

- P.A.S.S. technique
  - **Pull** the pin
  - **Aim** at base of fire
  - **Squeeze** handle
  - **Sweep** side-to-side at base of fire until fire appears out

Watch area for re-ignition and repeat steps 2 – 4;

**When in doubt,  
EVACUATE IMMEDIATELY!**



Source: OSHA

# Maintenance of Extinguisher

## Elements of inspection:

- Inspect bottle, handle, hose, and gauge for proper working order
- Inspection tag
  - Month and Year put in service current (annual)
  - Monthly visual inspections completed (monthly)
  - Extinguisher product still free-flowing inside bottle (turn upside down and/or shake)

# What's Wrong?



Source: OSHA



# What's Wrong?



Source: OSHA

# Knowledge Check

1. Which of the following statements is TRUE regarding Emergency Action Plans (EAPs)?
  - a. EAPs need to be written down only if requested by employees.
  - b. EAPs facilitate and organize actions taken during an emergency.
  - c. EAPs have no effect on the number or severity of injuries during an emergency.
  - d. EAPs increase confusion due to the number of documents required.

**Answer: b. EAPs facilitate and organize actions taken during an emergency**

# Knowledge Check

2. Fire Prevention Plan (FPP) requirements include all of the following, except \_\_\_\_.
- a. it must be written document that is kept in the workplace
  - b. it must be made available to employees for review
  - c. the employer must review with each employee the parts of the FPP necessary for self-protection
  - d. FPPs can be communicated orally if there are more than 10 employees

**Answer: d. FPPs can be communicated orally if there are more than 10 employees**

# Knowledge Check

3. Which of the following elements are required in order for a fire to occur?
- a. Sufficient oxygen, fuel, ignition source, and chemical reaction
  - b. Sufficient fuel, carbon dioxide, heat, and chemical reaction
  - c. Combustible materials, spark, heat, and mechanical reaction
  - d. Smoke, heat, flames, and light reaction

**Answer: a. Sufficient oxygen, fuel, ignition source, and chemical reaction**

# Knowledge Check

4. Only those employees who have received training on the use of a fire extinguisher can be authorized to use a fire extinguisher during a workplace fire.
- a. True
  - b. False

**Answer: a. True**

# Knowledge Check

5. Which of the following statements represents an element of a good emergency evacuation floor plan?
- a. Designates one exit pathway so as not to confuse evacuees
  - b. Indicates locations of elevators used to reach emergency exit
  - c. Directs exits away from rooms with hazardous materials
  - d. Indicates restrooms and windows as potential exits

**Answer: c. Directs exits away from rooms with hazardous materials**



# Knowledge Check

6. Trash fires involving paper and wood products are \_\_\_ fires.
- a. Class A
  - b. Class B
  - c. Class C
  - d. Class D

**Answer: a. Class A**

# Knowledge Check

7. Which fire extinguisher is appropriate for use on a fire involving gasoline in a confined space when no respiratory protection is available?
- a. Water (APW) extinguisher
  - b. Carbon dioxide extinguisher
  - c. Dry chemical extinguisher
  - d. Class K dry-type extinguisher

**Answer: c. Dry chemical extinguisher**

# Knowledge Check

8. The P.A.S.S. technique for using a fire extinguisher means \_\_\_\_.
- a. Position, aim, sweep, slowly
  - b. Pull, aim, squeeze, sweep
  - c. Point, away, side-to-side
  - d. Pin, approach, start, stop

**Answer: b. Pull, aim, squeeze, sweep**

# Knowledge Check

9. At minimum, how often must maintenance checks be performed on portable fire extinguishers?
- a. Once a month
  - b. Once a year
  - c. Once every two years
  - d. Once every five years

**Answer: b. once a year**